



# FIBER DUCT INSTALLATION IN TRENCH

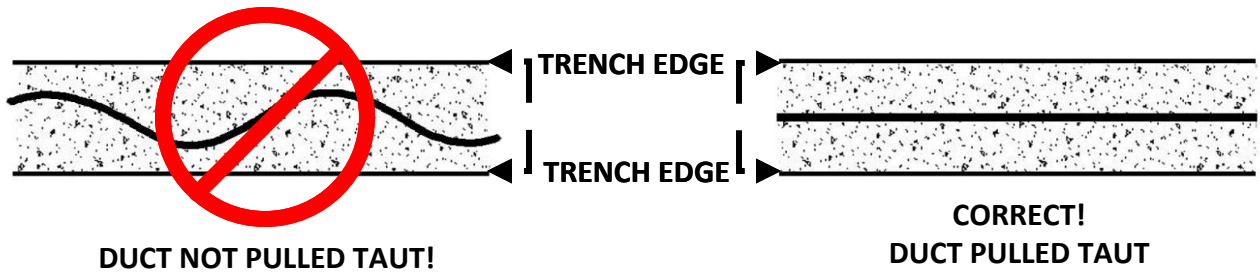

## PLOWING OR BORING FIBER DUCT INSTALLATION

Fiber duct bored or plowed in should be no less than 36 inches below finished grade. Multiple ducts may be installed together with 12 inches of separation from other utilities. Individual service drop installations to the structures shall not be less than 30".

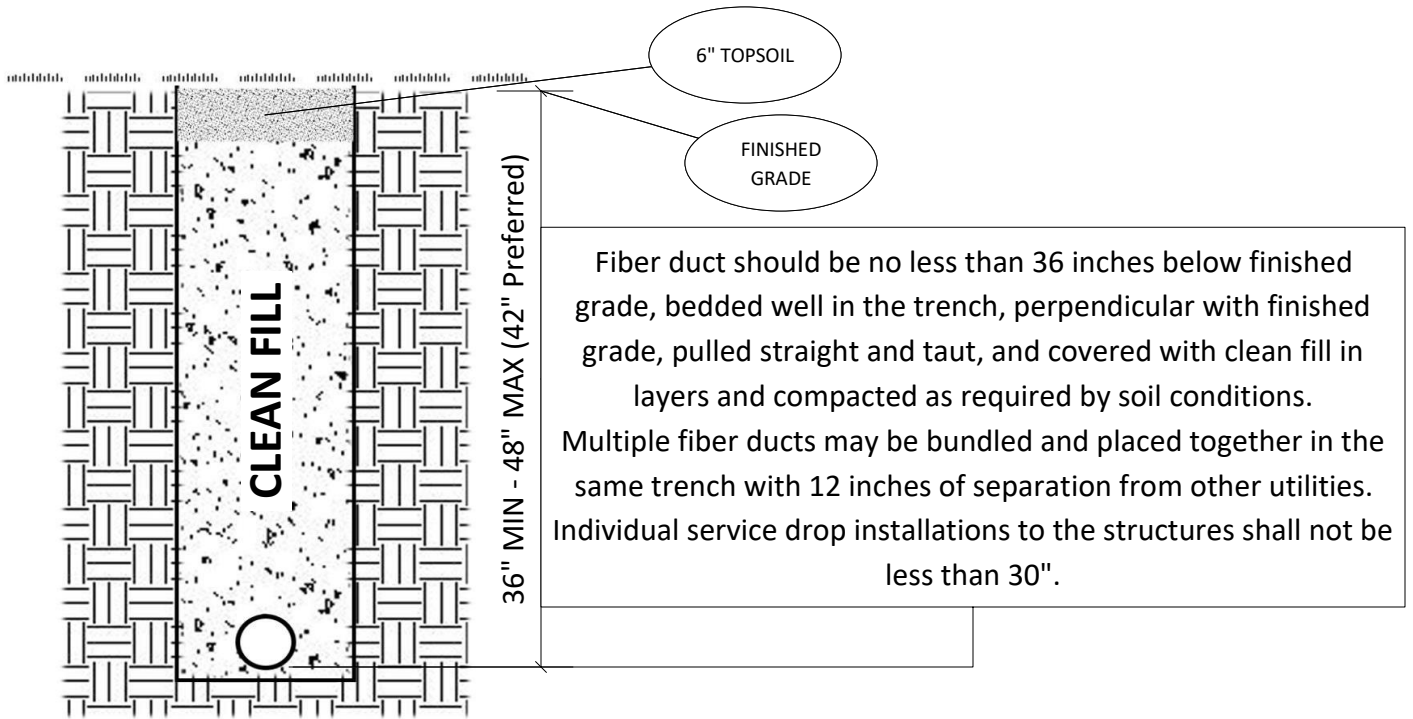